


# UNSATISFACTORY OR COMPROMISED UTM from RESPIRATORY SOURCES

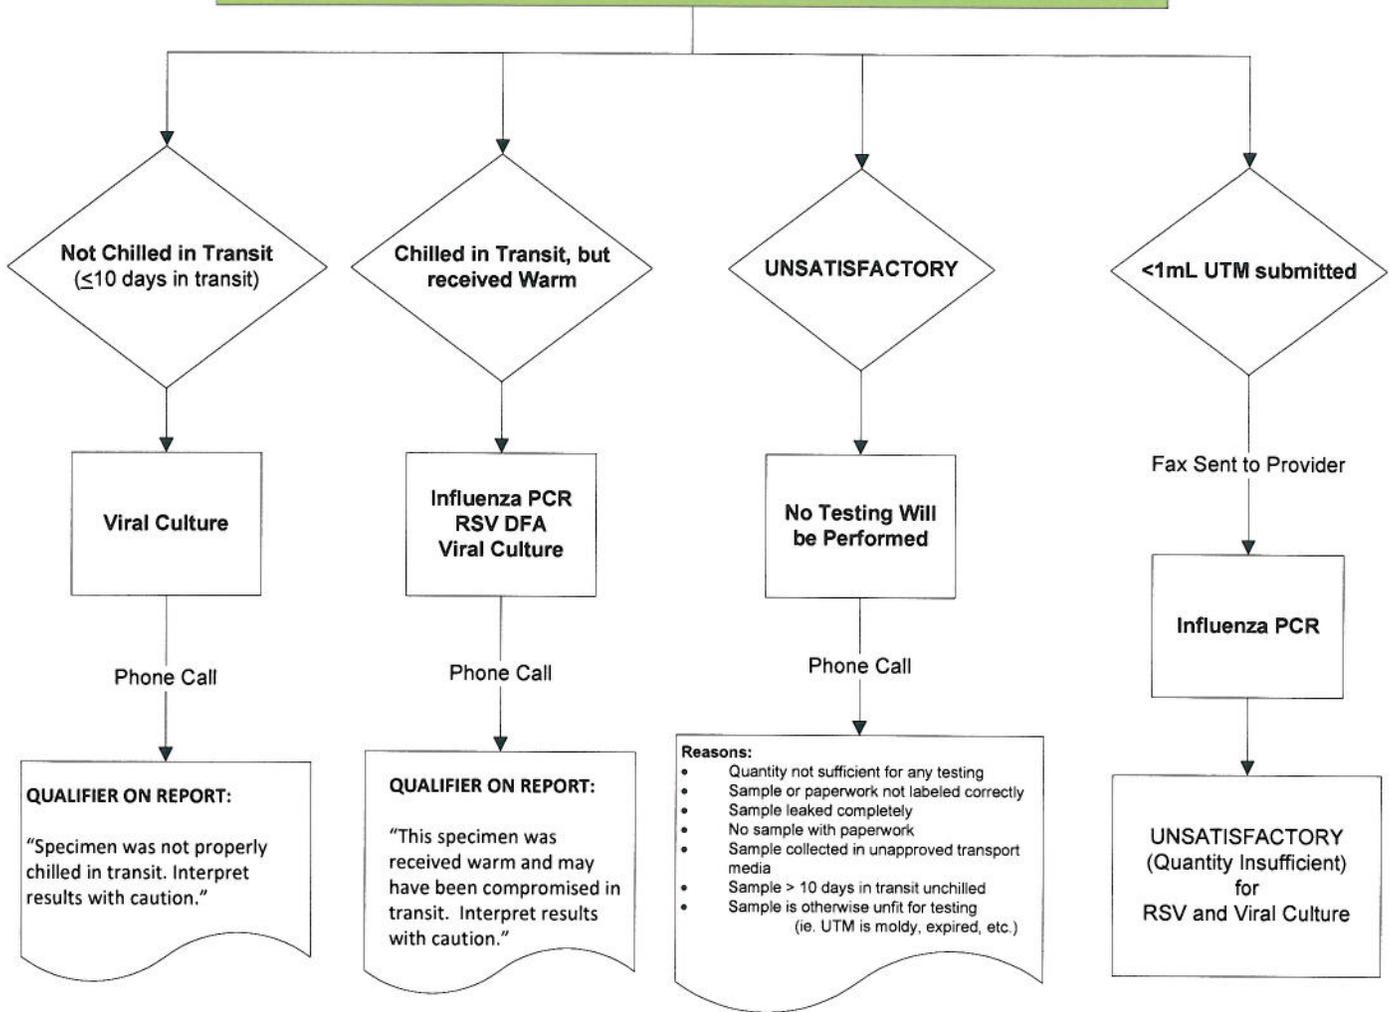

Please refer to our lab service manual for proper specimen collection and submission guidelines at [http://www.hss.state.ak.us/dph/labs/publications/image/Lab\\_Svcs\\_Manual.pdf](http://www.hss.state.ak.us/dph/labs/publications/image/Lab_Svcs_Manual.pdf)

If the sample is not chilled in transit, has been received warm, or has otherwise been noted as unsatisfactory for testing, your facility will be notified by a phone call within 24 hours of receipt of the specimen.

**If the sample has been collected in a 1mL UTM vial and will receive limited viral testing, your facility will be notified by fax.**

Please call us with any questions: (907) 474-7018